Map 6: Strategic energy opportunities

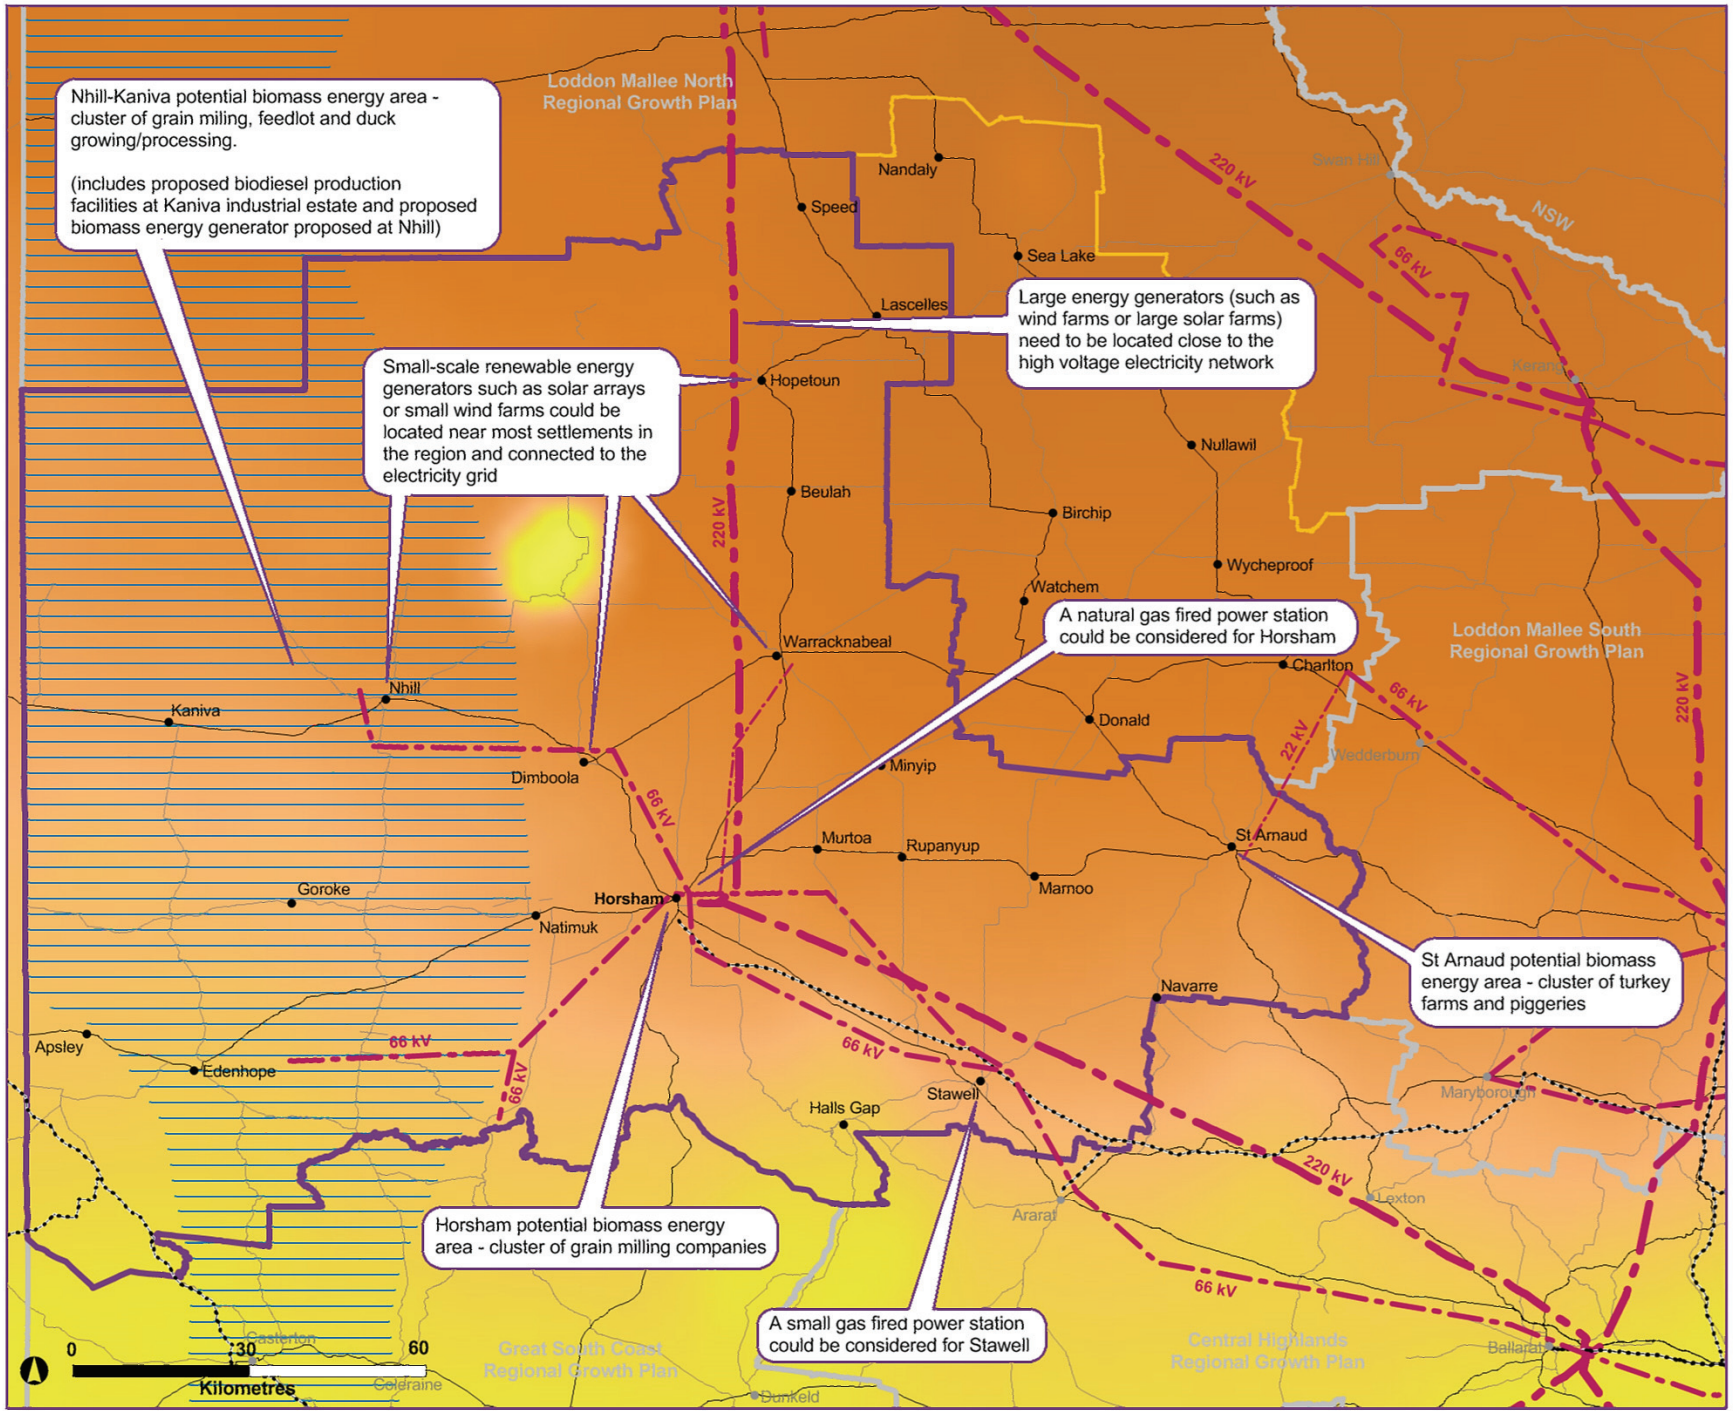

Electricity and gas

- 220 kV Transmission line
- 66 kV Sub-transmission line
- 22 kV Sub-transmission line
- Gas pipeline

Solar access - DNI (Annual)

(Watts per square metre)(1)

- 6.67 W/m²
- 6.02 W/m²
- 5.24 W/m²
- 4.02 W/m²
- 0

Geothermal

- Geothermal sub-surface temperatures at 1000 m(2)

- Settlement
- Wimmera Southern Mallee Regional Growth Plan area
- Buloke Shire boundary
- Highway
- Arterial road

(1) Direct Normal Irridance (DNI) - Direct Beam of the sun measured on a plane normal to the direction to the sun (W/m²). Data provided by Department of Primary Industries

(2) Sub-surface temperature between roughly 50-65°C

REGIONAL GROWTH PLANS A VISION FOR VICTORIA

State Government Victoria

©The State of Victoria, Department of Transport, Planning and Local Infrastructure, 2014. The State of Victoria does not warrant the accuracy or completeness of information in this publication and any person using or relying upon such information does so on the basis that the State of Victoria shall bear no responsibility or liability whatsoever for any errors, faults, defects or omissions in the information.